


## 7. Sound Pressure Level


### 7-1. Operation Sound Level

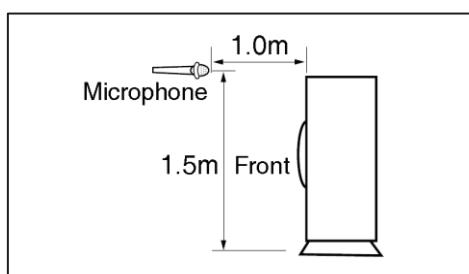


Model	Heating	Cooling
RC090MHX*	50	51
RC120MHX*	50	51
RC140MHX*	52	53
RC160MHX*	53	54

### 7-2. NC Curve


#### 1) RC090MHX\*

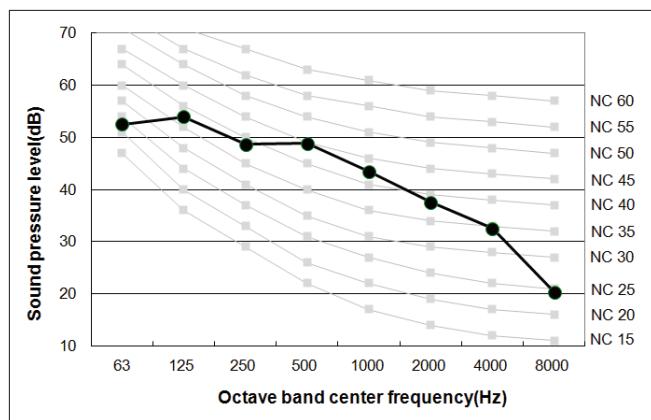


#### 2) RC120MHX\*

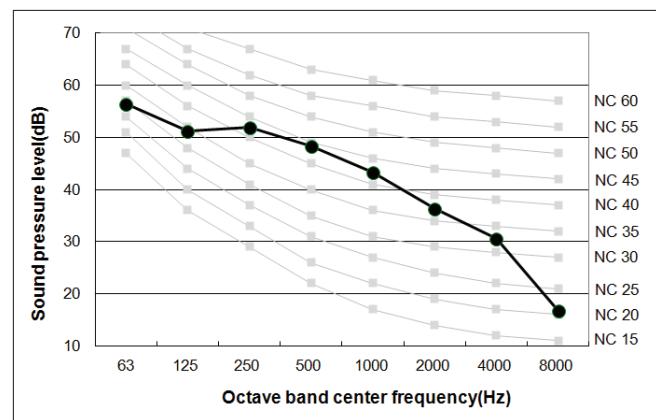

#### 3) RC140MHX\*

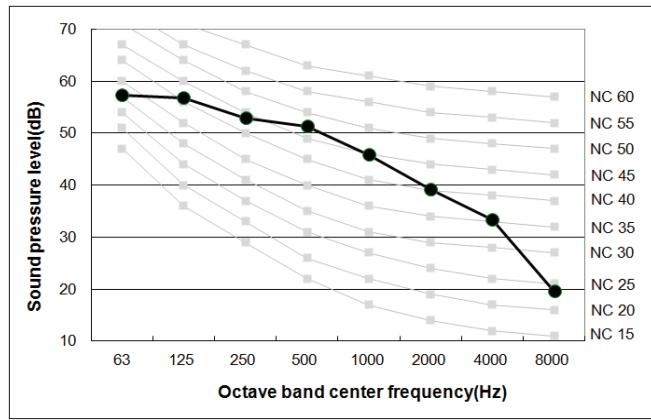

#### 4) RC160MHX\*

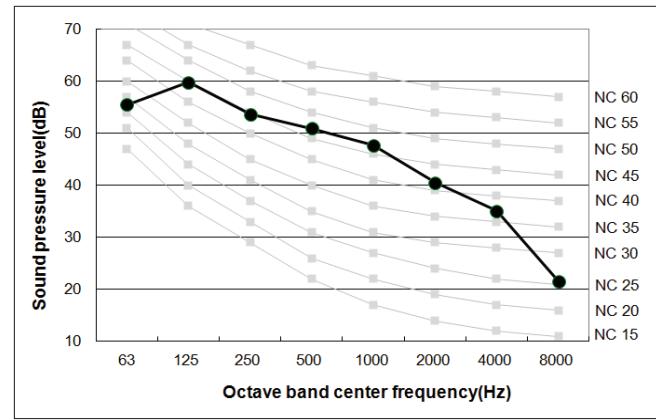

#### \* Notes

1. These operation sound value were obtained in an anechoic room. Sound pressure level will vary depending on a range of factors such as the construction of the particular room where the equipment is installed.
2. Operation sound level may differ depending on operation and ambient conditions.